


Tegnforklaring

- ▲ Ikke kritisk
- ▲ Lite kritisk

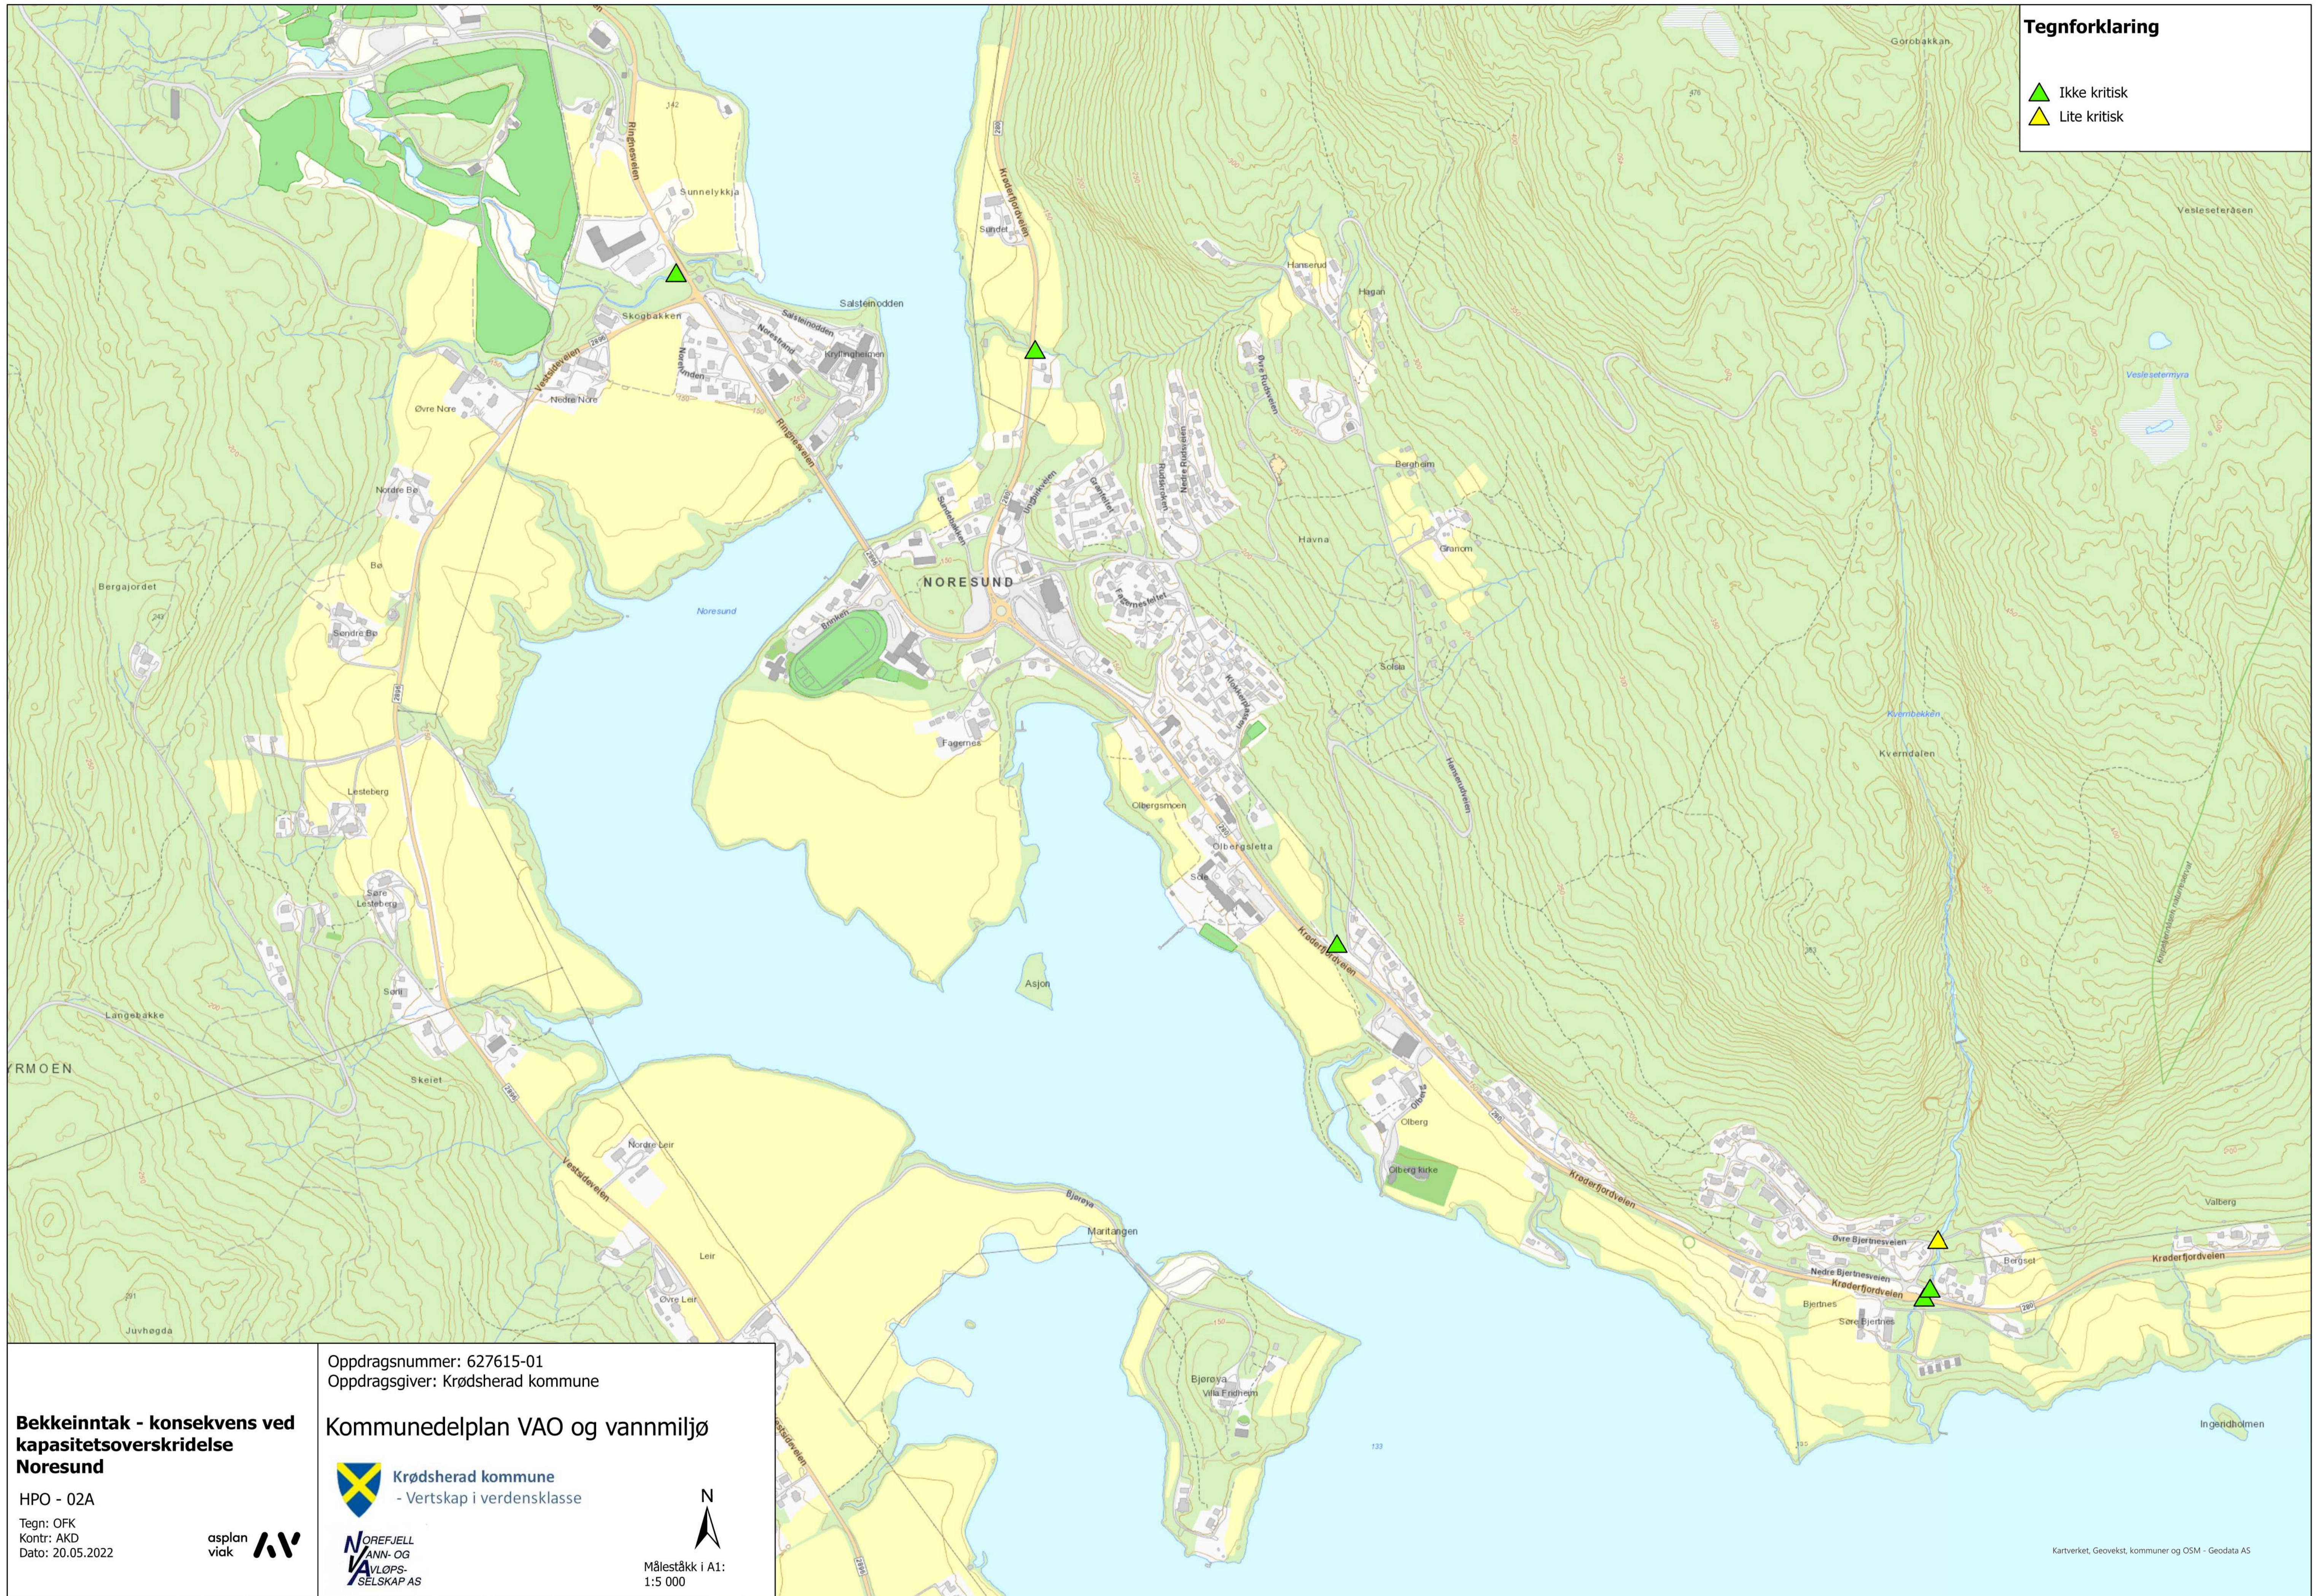

Bekkeinntak - konsekvens ved kapasitetsoverskridelse Noresund

HPO - 02A
Tegn: OFK
Kontr: AKD
Dato: 20.05.2022



Oppdragsnummer: 627615-01
Oppdragsgiver: Krødsherad kommune

Kommunedelplan VAO og vannmiljø

